
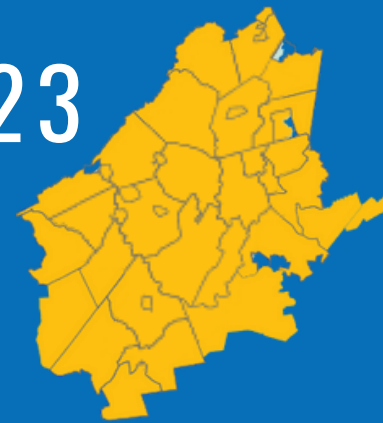



# WELL TESTING REPORT 2023

## DELAWARE TOWNSHIP




### 56 Taps Tested in Delaware Township


- Coliform Bacteria and E.coli
- Nitrates
- Arsenic
- Lead & Copper
- Volatile Organic Compounds
- Iron & Manganese
- Radionuclides (Gross Alpha and Radon)
- PFAS

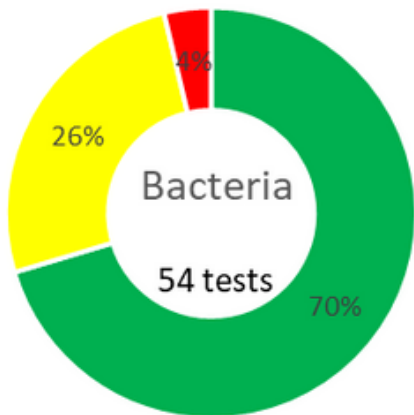


- Coliform bacteria absent
- Coliform bacteria present, E.coli absent
- E.coli present

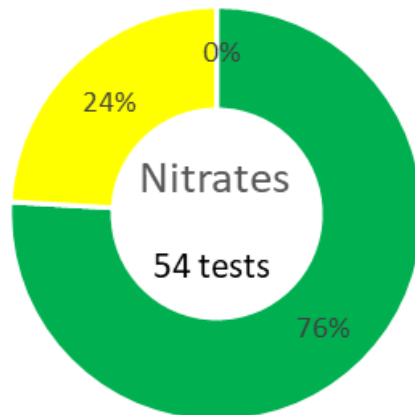


- Nitrates below 4 mg/L
- Nitrates 4-10 mg/L
- Nitrates failure - over 10 mg/L

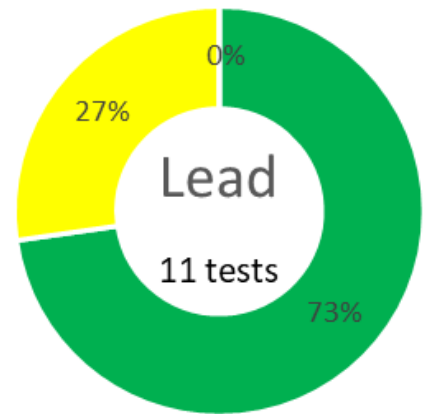


- Lead undetected
- Lead detected under MCL of 15 ppb
- Lead failure - over 15 ppb

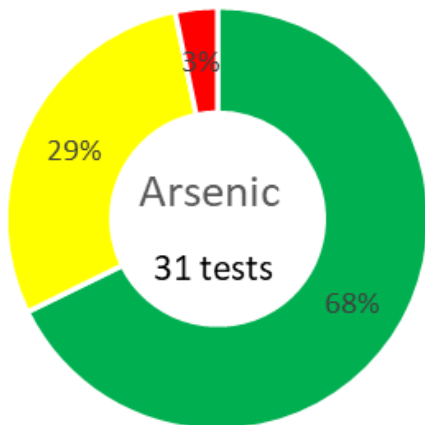

- Arsenic undetected
- Arsenic detected under 5 ppb
- Arsenic failure - over 5 ppb

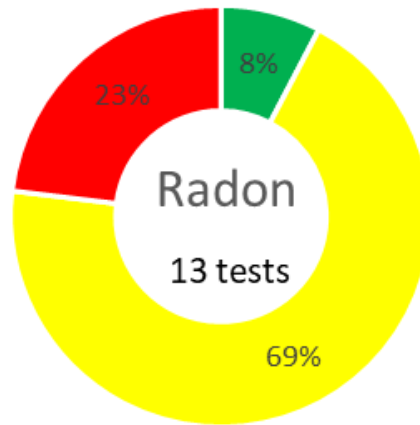

- Radon under 800 pCi/L
- Radon detected 800-4000 pCi/L
- Radon over 4000 pCi/L

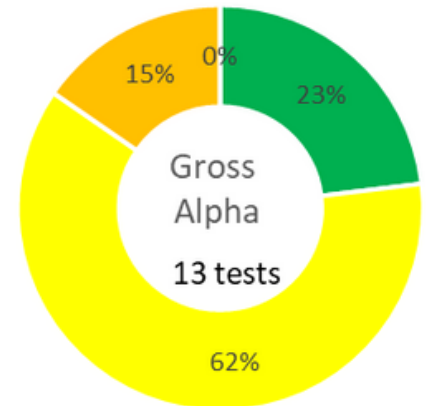

- Gross Alpha undetected
- Gross Alpha detected under 5 pCi/L
- Gross Alpha 5-15 pCi/L
- Gross Alpha over MCL of 15 pCi/L